



Typical Section Through Permanent Reinstatement of Longitudinal Opening in Roadway Scale 1:25

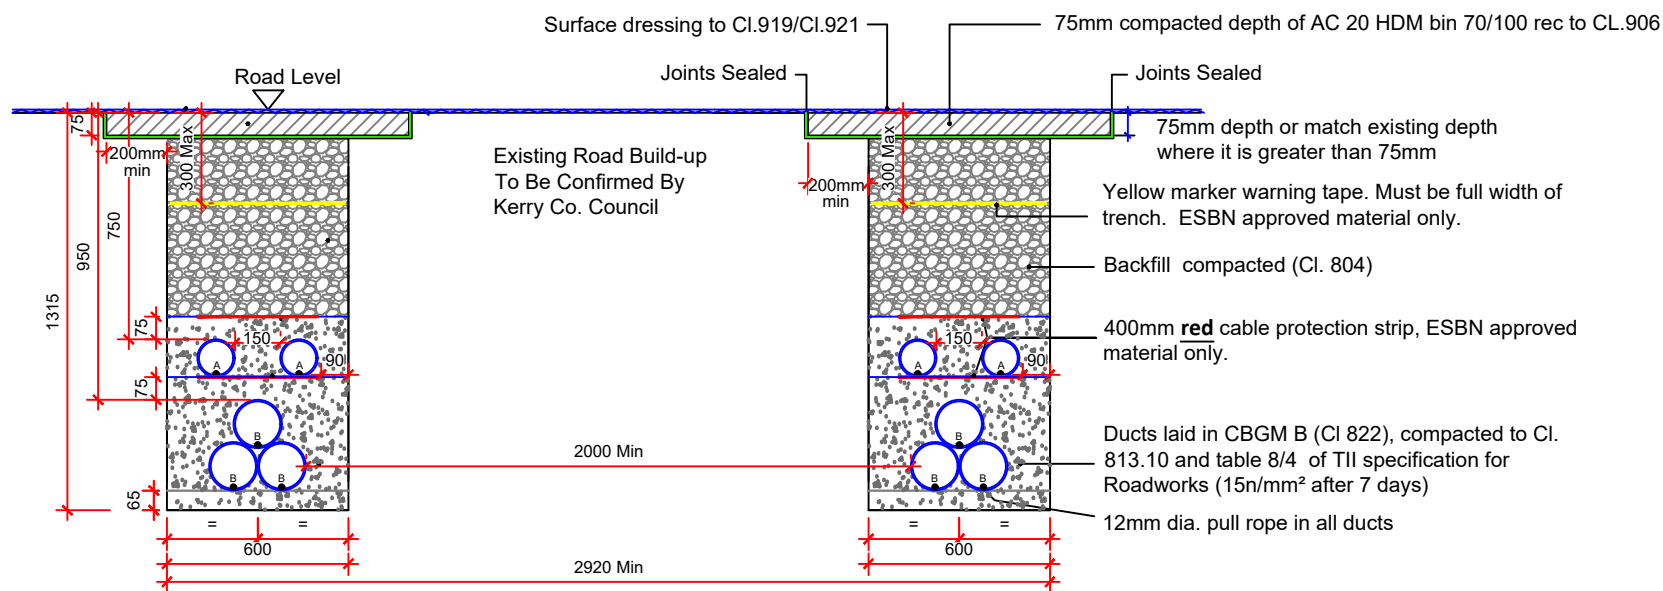

Typical Section Through Permanent Reinstatement of Longitudinal Opening in Dressed Rural Unbound Roadway Scale 1:25

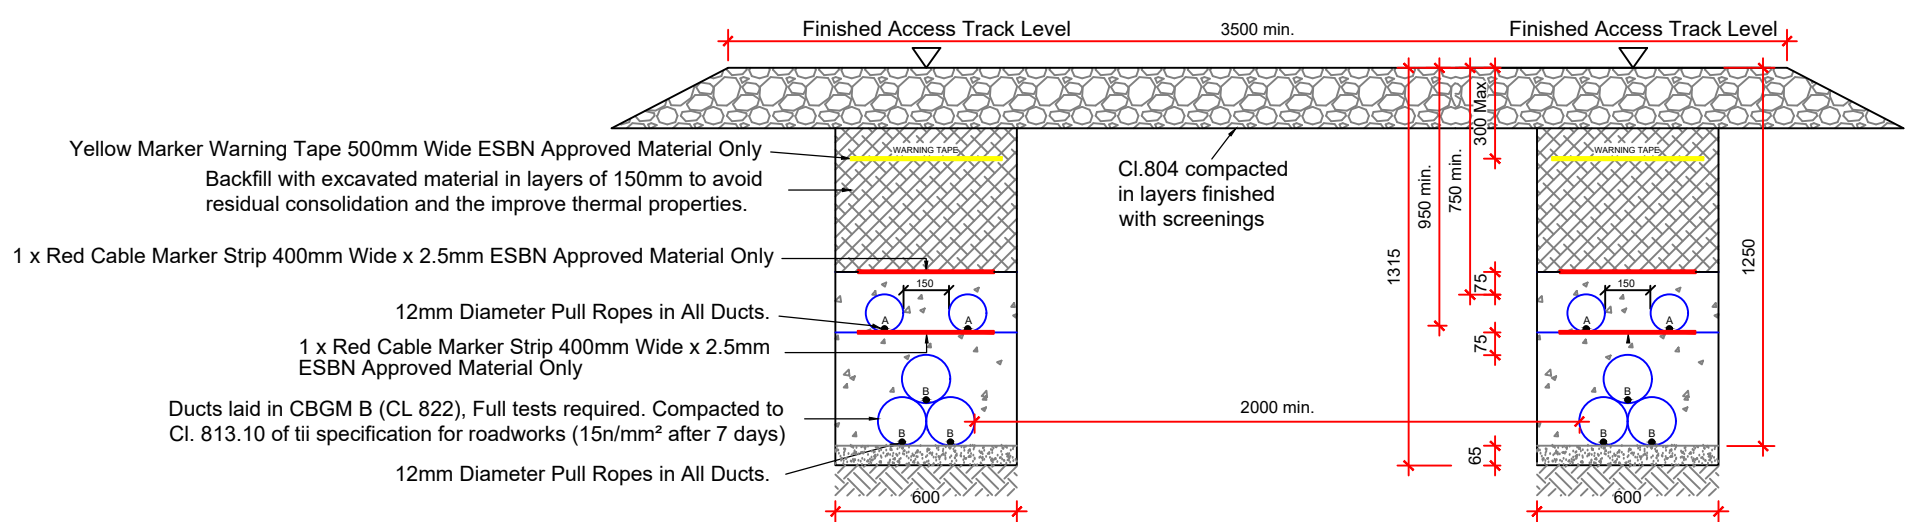

Typical Section Through Off Road Sections Scale 1:25

Note:

A = 125mm: Outer Diameter HDPE ESB Approved Duct, SDR =17.6

B= 160mm : Outer Diameter HDPE ESB Approved Duct, SDR = 21

REFERENCE DRAWINGS:

DRAWING No.	
19876-MWP-00-00-DR-C-5005	Proposed Site Layout - Master Sheet
19876-MWP-00-00-DR-C-5409	Proposed Substation Compound Layout

REV	DATE	DESCRIPTION	BY	APP
P01	14.01.2021	Issued For Planning	JK	KF

CLIENT:	Shronowen Wind Farm Limited
PROJECT:	Shronowen Wind Farm
TITLE:	Typical 110kV Cable Trench Details



Malachy Walsh and Partners
Engineering and Environmental Consultants

Cork | Tralee | London | Limerick

Reen Point, Blennerville, Tralee,
Co. Kerry, V92 X2TK

Tel : +353 (0)66 7123404
E-mail : tralee@mwp.ie



DRAWN: JK	CHECKED: KF	APPROVED: KF
DATE: December 2020	SCALE @ A3: 1:25	
PROJECT NUMBER: 19876	DRAWING STATUS: S2	
DRAWING NUMBER: 19876-MWP-00-00-DR-C-5419	REV: P01	